

**OPEN**  
Compute Project

# **CG-OpenRack-19**

## **Sled and Rack Specification**

### **Version 1.0**

**Authors:**

**Matt St Peter**, Hardware Architect, Radisys Corporation

**Nilan Naidoo**, Software Architect, Radisys Corporation

# 1 Revision History

Date	Name	Description
11/16/2016	Radisys Corp	Version 1.0

Radisys would like to acknowledge Damascene Joachimpillai of Verizon Communications as a key contributor to this concept and specification.

## 2 Contents

1	Revision History .....	2
2	Contents .....	3
3	License .....	4
4	Scope .....	4
5	Overview .....	5
6	Sled Physical Specifications .....	7
6.1	Sled Common Mechanical Dimensions .....	8
6.2	Sled Optical Connector Placement .....	9
6.3	Sled Power Connector Placement .....	10
6.4	Half-Width Sled Mechanical Dimensions .....	11
6.5	Full-Width Sled Mechanical Dimensions .....	12
6.6	Mechanical Retention and Handle Features .....	13
6.7	Sled Front Interface .....	17
6.8	Weight and Structure .....	18
7	Rack Physical Specifications .....	18
7.1	Bus Bar Pair Construction .....	19
7.2	Bus Bar Location .....	19
7.3	Shelf Retention Feature .....	20
7.4	Shelf Latch Feature .....	20
8	Sled Optical Data Port Requirements .....	21
8.1	Sled Common Data Port Requirements .....	21
8.2	Sled to Shelf Interconnects .....	22
8.3	Interconnect Topology Example .....	23
9	Electrical Specifications .....	24
9.1	Power .....	24
9.2	Signal Interface .....	26
9.3	Electromagnetic Interference Mitigation .....	28
10	Management .....	28
11	Appendix .....	30
11.1	Appendix: Commonly Used Acronyms .....	30

## 3 License

As of Nov-15-2016, the following persons or entities have made this Specification available under the OWFa1.0, which is available at <http://www.openwebfoundation.org/legal/the-owf-1-0-agreements/owfa-1-0>. Contributors expressly reserve all ownership and other rights, title, and interest in and to the Specification. Contributors do not make or agree to make, and nothing in the license or the making available of the Specification constitutes, or shall be interpreted or deemed to be, any assignment, transfer, conveyance, or grant of any ownership, co-ownership, right, title, interest, license (except as expressly set forth in the OWFa1.0), security interest, or encumbrance, or any claim thereto.

Radisys Corporation

You can review the signed copies of the Contributor License for this Specification on the OCP website <http://opencompute.org/>, which may also include additional parties to those listed above.

Your use of this Specification may be subject to other third party rights. THIS SPECIFICATION IS PROVIDED "AS IS." The contributors expressly disclaim any warranties (express, implied, or otherwise), including implied warranties of merchantability, non-infringement, fitness for a particular purpose, or title, related to the Specification. The entire risk as to implementing or otherwise using the Specification, including, without limitation, the risk of any infringement or misappropriation, is assumed by the Specification implementer and user. IN NO EVENT WILL ANY OF THE CONTRIBUTORS BE LIABLE TO ANY OTHER PARTY OR PERSON FOR LOST PROFITS OR ANY FORM OF DIRECT, INDIRECT, SPECIAL, INCIDENTAL, OR CONSEQUENTIAL DAMAGES OF ANY CHARACTER FROM ANY CAUSES OF ACTION OF ANY KIND WITH RESPECT TO THIS SPECIFICATION OR ITS GOVERNING AGREEMENT, WHETHER BASED ON BREACH OF CONTRACT, TORT (INCLUDING NEGLIGENCE), OR OTHERWISE, AND WHETHER OR NOT THE OTHER PARTY OR PERSON HAS BEEN ADVISED OF THE POSSIBILITY OF SUCH DAMAGE.

CONTRIBUTORS AND LICENSORS OF THIS SPECIFICATION MAY HAVE MENTIONED CERTAIN TECHNOLOGIES THAT ARE MERELY REFERENCED WITHIN THIS SPECIFICATION AND NOT LICENSED UNDER THE OWF CLA OR OWFa. THE FOLLOWING IS A LIST OF MERELY REFERENCED TECHNOLOGY: INTELLIGENT PLATFORM MANAGEMENT INTERFACE (IPMI). IMPLEMENTATION OF THESE TECHNOLOGIES MAY BE SUBJECT TO THEIR OWN LEGAL TERMS.

## 4 Scope

CG-OpenRack-19 is a scalable carrier-grade rack level system that integrates high performance compute, storage and networking in a standard rack. As such, there are many possible system configurations. However, certain rules and requirements ensure that different modules will operate properly in compliant systems.

This document provides the detailed interoperability requirements of a CG-OpenRack-19 sled as well as the rack system. This document describes the physical makeup of the rack and sled with a focus on the interface between the sled and the supporting rack-level infrastructure. This includes mechanical requirements as well as requirements related to electrical power feeds, optical and electrical interfaces, airflow and cooling, and environmental robustness.

Specific thermal requirements have been purposely omitted due to the diverse range of system deployment scenarios which will ultimately dictate a variety of solutions.

Mechanical dimensions and positioning relative to the frame/cabinet have been purposely omitted to allow flexible solutions.

## 5 Overview

This section describes the physical components of a rack-level system and their internal and external connections. In general, the system is made up of compute- and storage-centric sleds, Ethernet switches, a power source, and supporting rack infrastructure as shown in Figure 1.

There are five major system component types: the system rack, power conversion/distribution, Top-of-Rack switches, and two sizes of modular sleds housing compute and storage elements. A shelf includes one or two bays into which sleds fit.

- **System Rack:** The rack provides physical structure for the system, airflow control, security, and network interconnects.
- **Power Source:** Rack-mount power conversion and distribution infrastructure that provides a nominal 12VDC to two bus bar pairs mounted at the rear of the system. This specification only defines the 12VDC power delivery from the converters to the sleds.
- **Half-Width Sled:** A 2U enclosure that takes up half of the shelf width and fits into a 2-bay shelf. A common use of this sled size is to provide high density compute resources.

- Full-Width Sled: A 2U enclosure that takes up the full shelf width and fits into a 1-bay shelf. A common use of this sled size is to provide high capacity/throughput storage resources.
- Top-of-Rack (ToR) Switch: Each rack can be equipped with a variable number of management plane and data plane switches. Each of these aggregates management and/or data traffic to internal network switching planes; for example:
  - Device Management Switch: 1GbE downlink management traffic interfaces (e.g., to BMCs) and 10GbE uplink interfaces.
  - Application Management Switch: 1GbE downlink management traffic interfaces (e.g., to payload processors) and 10GbE uplink interfaces.
  - Primary Dataplane Switch: 10GbE downlink data plane traffic interfaces (e.g., to payload processors) and 40GbE uplink interfaces.
  - Secondary Dataplane Switch: 10GbE downlink data plane traffic interfaces (e.g., to payload processors) and 40GbE uplink interfaces.

Although the switch topology is not a fixed system requirement, it is recommended that a rack system include at least a Device Management Switch and Primary Dataplane Switch. Redundancy may or may not be part of the system configuration, depending on the application usage.

**Figure 1. Rack with Half-Width and Full-Width Sleds**

## 6 Sled Physical Specifications

The sleds are based on a uniform form factor that allows interoperability with the rack, and specifically the CG-OpenRack-19 shelves. They must have specific external dimensions, with external connections and features at specified locations in order to interoperate with the rack.

Sleds are positioned at a 2RU vertical pitch. The number of shelves within a rack is flexible, and can be defined by the required density or application. The vertical bus bars must be set to cover the sled area, or can extend beyond the sled area.

All dimensional tolerances are per DIN ISO 2768-mK, except sled height, width, and depth, which is  $\pm 0.20\text{mm}$ .

Appropriate cooling **shall** be provided by each sled according to its own needs within the expected system deployment model. This may be accomplished with fans or air movers within the sled enclosure.


Sled airflow **should** be front-to-back for all sleds with fans or other air movers.

## 6.1 Sled Common Mechanical Dimensions

All shelves **shall** occupy a vertical spacing of 2 Rack Units (RU), equivalent to 3.50 inches (88.9mm).


All sleds **shall** have a vertical height of 84.0mm  $\pm$ 0.20mm as measured from the bottom face to the top face.

**Figure 2. Sled Vertical Height (front view)**

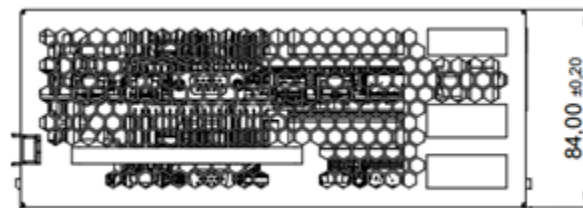


All sleds **shall** have a horizontal depth of 780.0mm  $\pm$ 0.20mm as measured from the front face to the rear face.

**Figure 3. Sled Horizontal Depth (side view)**

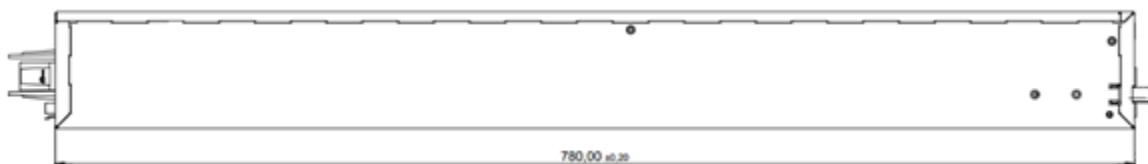


All sleds **shall** have a 6.4mm hole on the rear sled face to receive alignment pin with maximum penetration of 21.5mm. The hole **shall** be 16.3mm above the bottom face of the sled enclosure and 59.5mm from the right face of the sled enclosure.

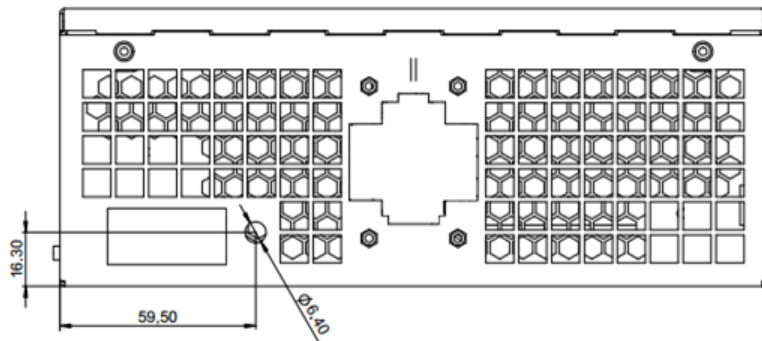

**Figure 4. Sled Alignment Pin Hole (rear view)**


## 6.2 Sled Optical Connector Placement

All sled optical connectors **shall** have a nominal centerline position 32.50mm from the right face of the sled enclosure, and a mounting hole position 13.50mm from the rear face of the sled enclosure.

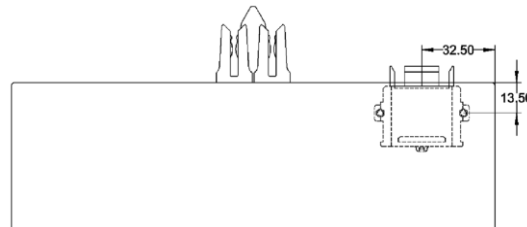**Figure 5. Sled optical connector horizontal position (top-down view)**

All sled optical connectors **shall** have a nominal centerline position 14.51mm from the bottom face of the sled enclosure.


**Figure 6. Sled optical connector vertical position (rear view)**

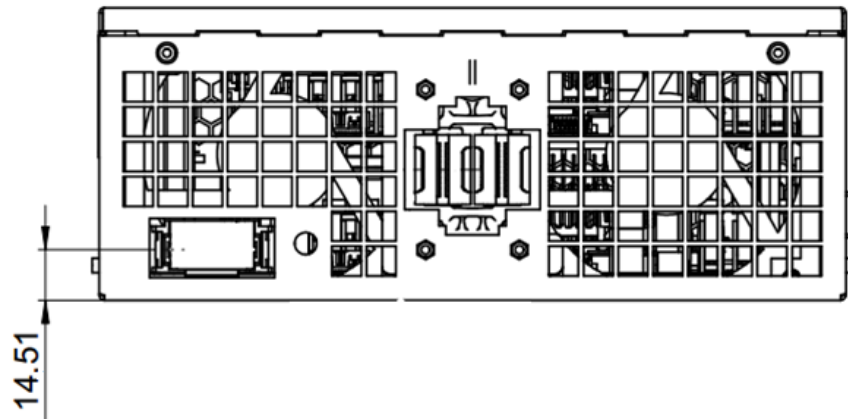

### 6.3 Sled Power Connector Placement


All sled DC power connectors **shall** have a nominal centerline position 107.50mm from the right face of the sled enclosure.

**Figure 7. Sled Power connector horizontal position (top-down view)**

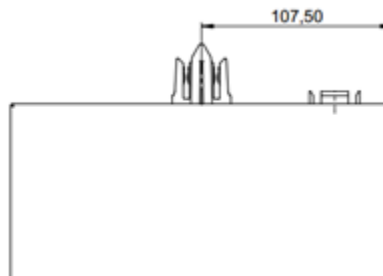

All sled DC power connectors **shall** have a nominal centerline position 37.50mm from the bottom face of the sled enclosure.

Figure 8. Sled power connector vertical position (rear view)

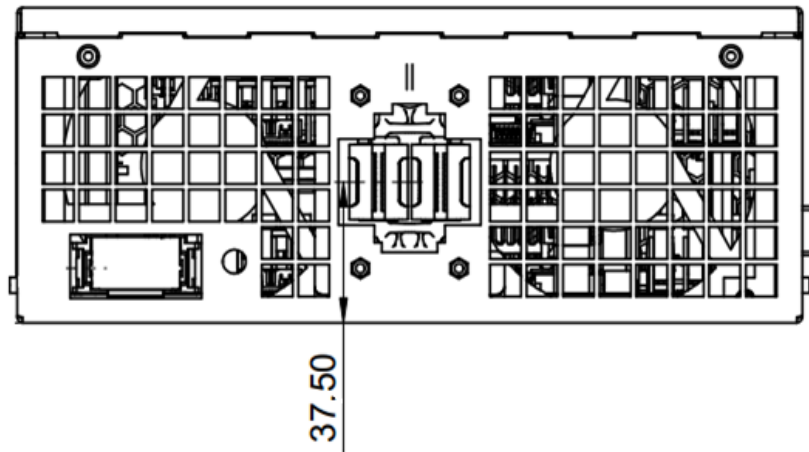


#### 6.4 Half-Width Sled Mechanical Dimensions

The half-width sleds share a common height and depth with full-width sleds. They occupy half of a shelf (left or right side), and fit two-across.


Half-width sleds **shall** have a horizontal width of  $215.0\text{mm} \pm 0.20\text{mm}$  as measured from the left face to the right face.

Figure 9. Half-width sled horizontal width (front view)

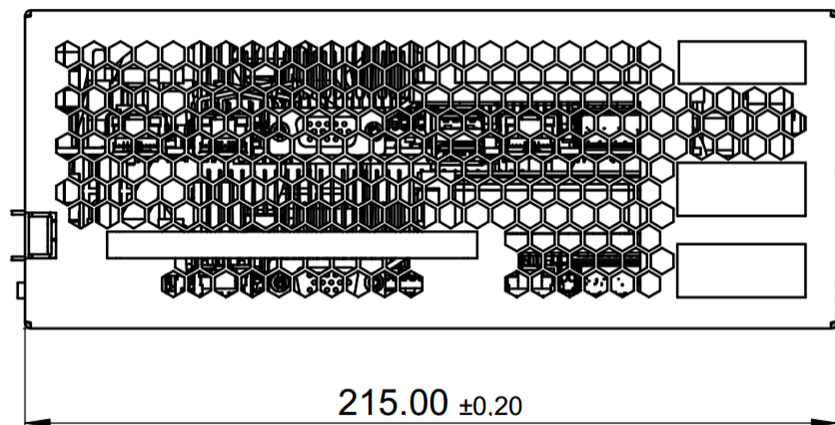

Half-width sled front handles **shall** have a nominal centerline position  $144.25\text{mm}$  from the right face of the sled enclosure.

**Figure 10. Half-width sled handle horizontal position (top-down view)**

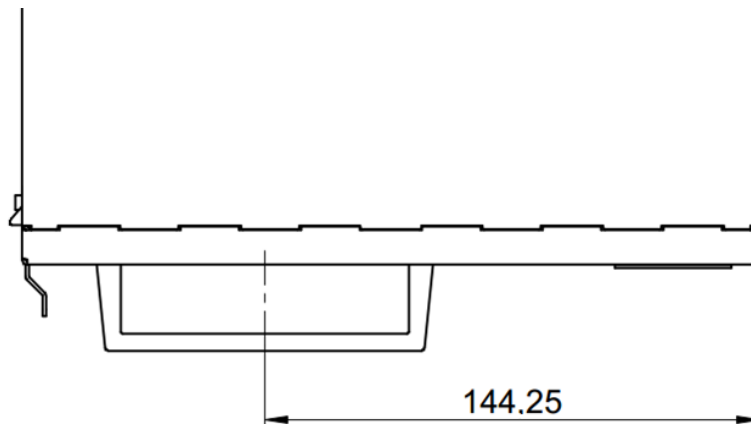


## 6.5 Full-Width Sled Mechanical Dimensions

The full-width sleds share a common height and depth with half-width sleds. They occupy the full width of a shelf.


Full-width sleds **shall** have a horizontal width of 444.00mm  $\pm 0.20$ mm.

**Figure 11. Full-width sled horizontal width (front view)**

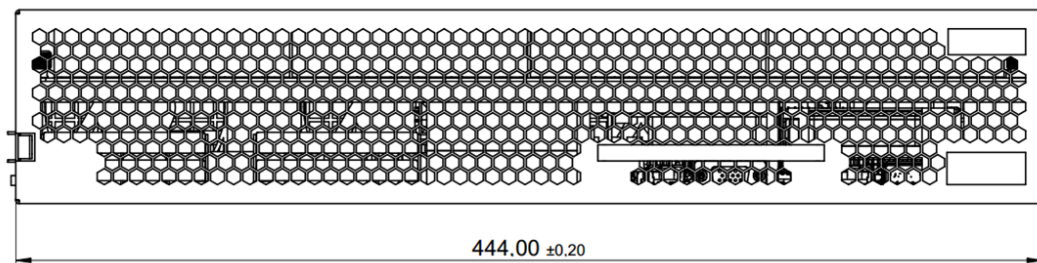

Full-width sled front handles **shall** have a nominal centerline position 143.25mm from the right face of the sled enclosure.


Figure 12. Full-width sled handle horizontal position (top-down view)

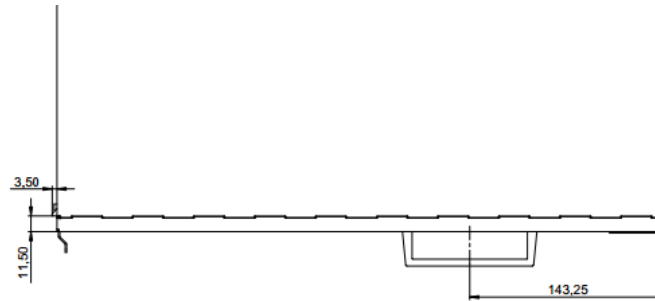

## 6.6 Mechanical Retention and Handle Features


All sled retention latches **shall** extend a minimum of 3.50mm from the left face of the sled enclosure.

Figure 13. Sled retention latch extension (top-down view)

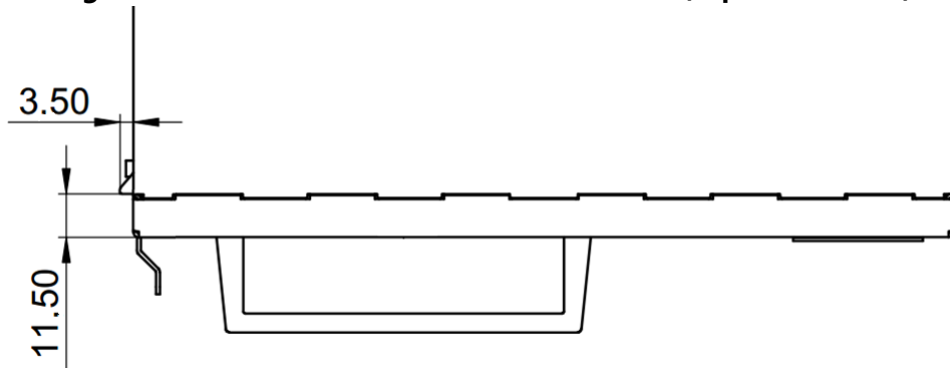


All sled retention latch forward faces **shall** be set back 11.50mm from the front face of the sled enclosure.

**Figure 14. Suggested retention latch dimensions (top-down view)**

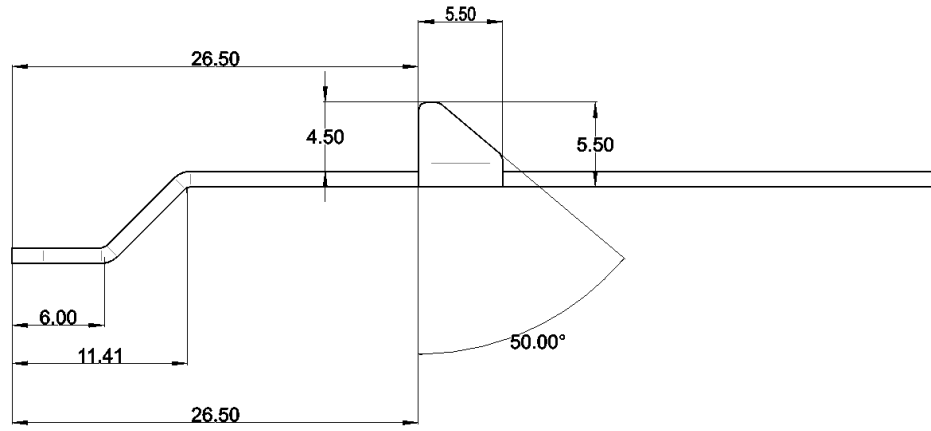


All sled retention latches **shall** have a height of 13.10mm and be 17.96mm above the bottom face of the sled enclosure.


**Figure 15. Sled retention latch vertical position (front view)**

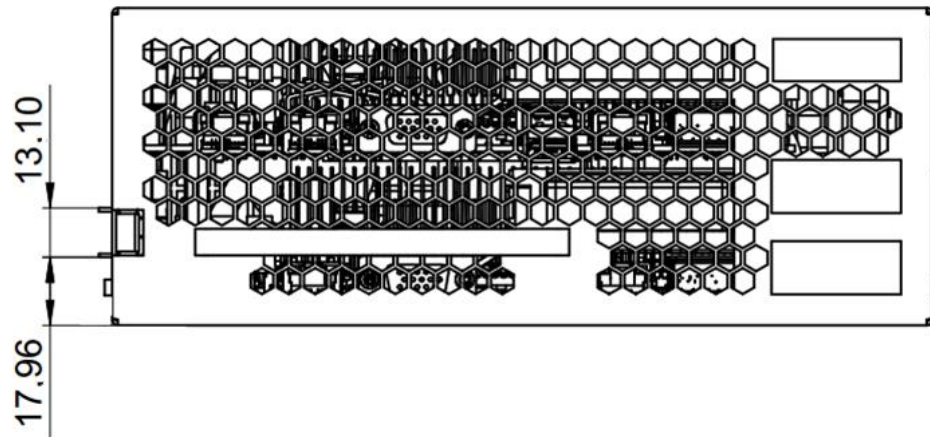

All sleds **shall** include retention pins extending 2.0mm +/-0.1mm from the left and right enclosure faces.

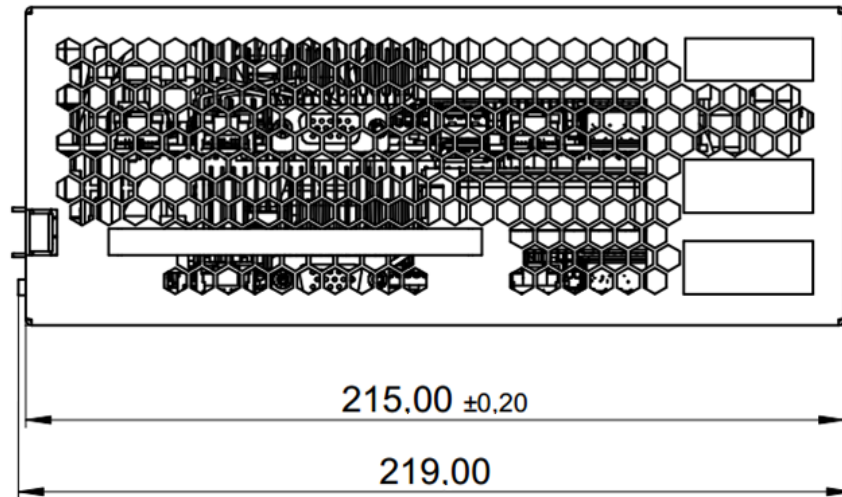
**Figure 16. Sled retention pin horizontal extension (front view)**

Sled retention pins **shall** be 4.20mm +/-0.1mm in diameter, and shall be 18mm from the enclosure front face and 10.00mm from the enclosure bottom face.

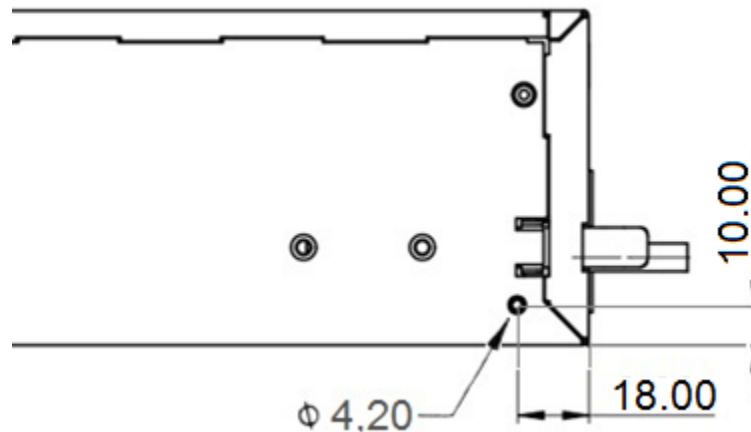**Figure 17. Sled retention pin horizontal extension (front view)**


All sled front handles **should** extend 25.00mm from the front face of the enclosure.

**Figure 18. Sled handle horizontal extension (side view)**

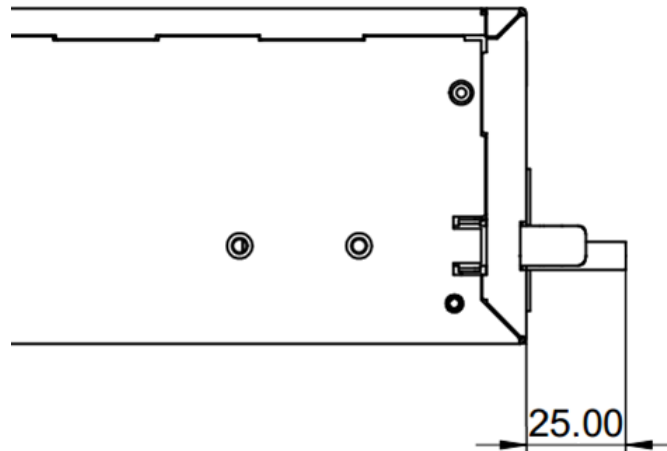

All sled front handles **should** be centered 22.00mm from the bottom face of the enclosure.


**Figure 19. Sled handle vertical position (side view)**

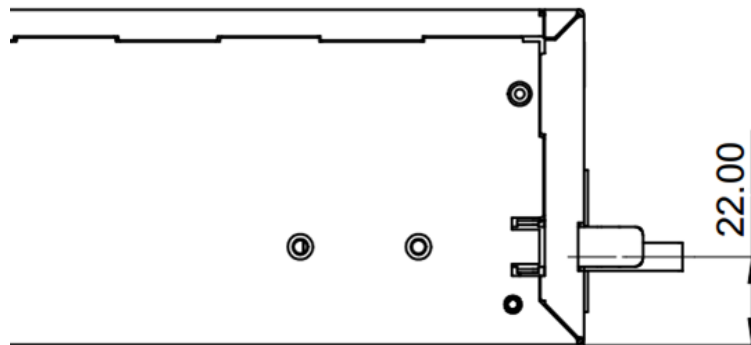

All sled front handles **should** comply with the following dimensions.



Figure 20. Sled handle dimensions

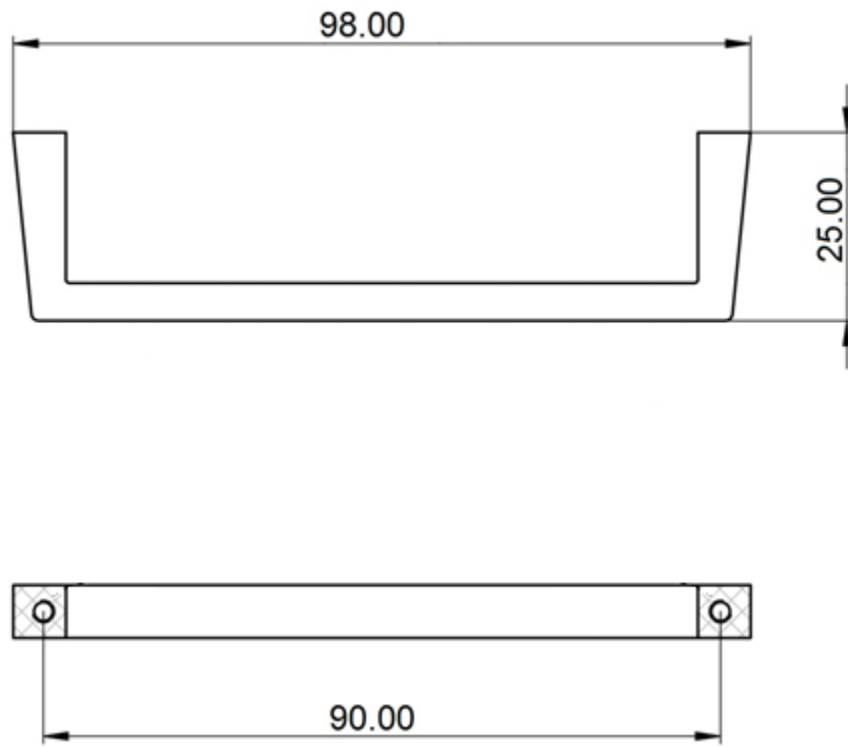


## 6.7 Sled Front Interface

The front of each sled provides status information and allows operator input by way of indicator(s) and button(s). In order to give the operator a consistent interface, the following dimensions and functions should be followed, at a minimum.

Additional/alternate items are not precluded.

All sleds **should** include one operator panel for each separately managed server node. The dimensions of each panel are 34mm width and 14mm height.

**Figure 21. Sled Operator Panel Art and Dimensions**

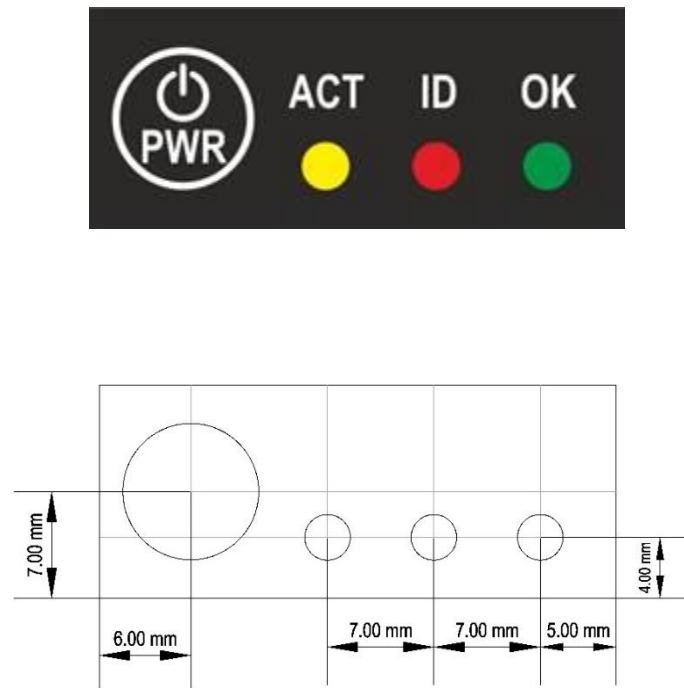

## 6.8 Weight and Structure

CG-OpenRack-19 sled weights may vary over a wide range depending on the composition of the enclosure and the type of internal components.

**Table 1. Sled expected nominal and maximum weights**

Sled Type	Nominal Weight	Expected Max. Weight
Half-Width	25lbs, 11.4kg	30lbs, 13.6kg
Full-Width	65lbs, 29.5kg	75lbs, 34.0kg

## 7 Rack Physical Specifications


In order to achieve interoperability between sleds and the rack, certain dimensions of the rack, specifically the shelves, must be followed.

## 7.1 Bus Bar Pair Construction

The rear bus bar pairs provide 12VDC to the installed sleds.

The vertical bus bar pairs **shall** be constructed in compliance with the following dimensions.

**Figure 22. Bus bar pair dimensions (top view)**

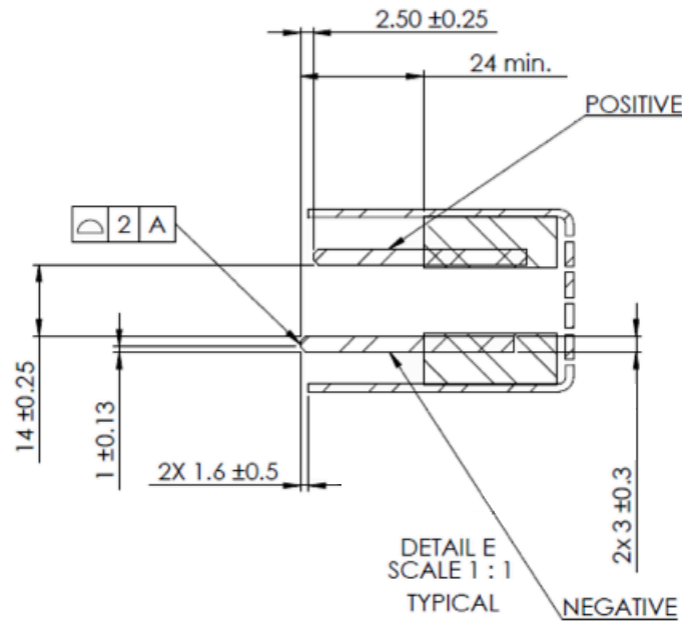


## 7.2 Bus Bar Location

The rack **shall** have two vertical bus bar pairs to the rear of all shelves.

Each right-hand (facing front) vertical bus bar pair **shall** be centered 108mm ±0.20mm from the right side of the sled bay wall. Each left-hand vertical bus bar pair

**shall** be centered 229mm  $\pm 0.20$ mm from the right-hand pair. The bus bar pairs **shall** be positioned as follows relative to the shelf back wall and sled stop.


**Figure 23. Bus bar pair horizontal location (top view)**

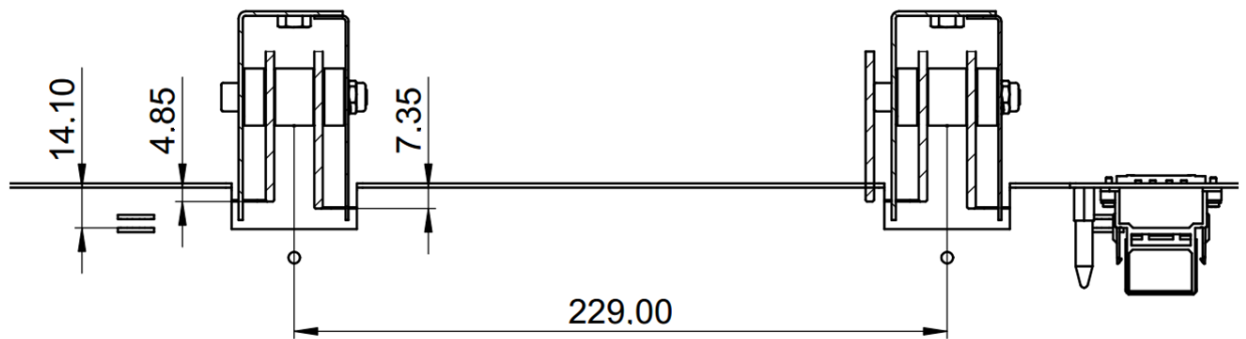

### 7.3 Shelf Retention Feature


Each shelf **shall** have two retention slots at the front of each bay with the following dimensions.

**Figure 24. Shelf retention slot locations**

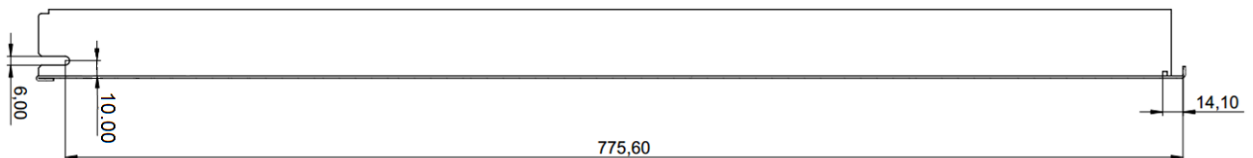

### 7.4 Shelf Latch Feature

Each shelf **shall** have two latch openings at the front of each bay with the following dimensions.

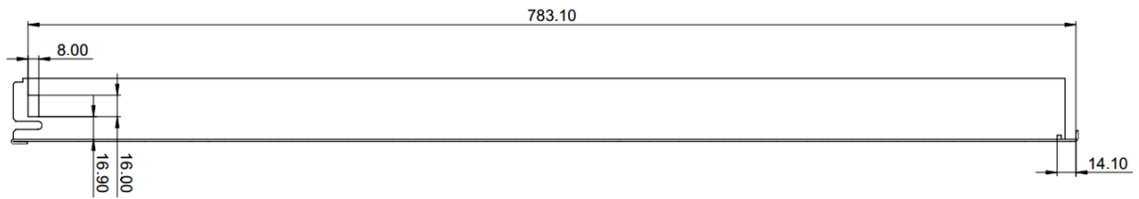**Figure 25. Shelf latch opening locations**

## 8 Sled Optical Data Port Requirements

All sleds have a rear-mounted blind-mate optical housing that supports data-plane and management plane connections to the spine switches. In order to interoperate with the connections made in the rack, the fiber positions in the rear connector must match the defined positions of the shelf connector.

All data and management interconnects between the sleds and the rack infrastructure pass through a single blind-mate connector housing set. Sleds have a rear-mounted blind-mate "daughtercard" optical housing that mate with a compatible "backplane" housing on the rear of the CG-OpenRack-19 shelves. In order to interoperate, both the shelf and the sleds must use the same ferrule and fiber position assignments.

The optical blind-mate connector housing supports four ferrules. Standard ferrules are available with 24 fiber positions (or more). The typical number of fiber positions in CG-OpenRack-19 is 12, and 8 fibers are loaded on each ferrule. The ferrule positions are color-coded, with each color corresponding to one of four network types.


### 8.1 Sled Common Data Port Requirements

Each compute or storage shelf has two or one "backplane" housings (respectively) that will blind-mate with the "daughtercard" version of the housing that is part of the installed sled.

All interfaces between server nodes and the rack infrastructure pass through the blind-mate optical connector at the rear of the compute and storage sleds.

The housing has four sections, each of which is capable of holding a single fiber optic ferrule. The sections are color coded

**Figure 26. Sled blind-mate section assignments (rear view)**

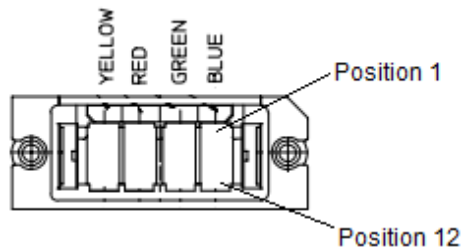

Sleds **should** use the green section of the rear optical connector for Application Management links.

Sleds **should** use the blue section of the rear optical connector for Device Management links.

Sleds **should** use the yellow section of the rear optical connector for Primary Data-plane links.

Sleds **should** use the red section of the rear optical connector for Secondary Data-plane links.

Note that alignment of blind-mate optical connections with a specific switching topology is not strictly specified in order to allow flexibility within a rack. However, a precise scheme must be adhered to for consistent application behavior.

## 8.2 Sled to Shelf Interconnects

All interfaces between server nodes and the rack infrastructure pass through the blind-mate optical connector at the rear of the compute and storage sleds.

**Table 2. Sled Interconnect Components**

Assembly mounting	Connector description	Manufacturing part number
Sled	HBMT daughtercard housing	(Molex) 106105-2100
Sled	Power rail connector	(Methode) 5313-07458-00107

**Table 3. Shelf Interconnect Components**

Assembly mounting	Connector description	Manufacturing part number
Shelf	HBMT backplane housing	(Molex) 106105-2000


### 8.3 Interconnect Topology Example

To illustrate how the interconnect scheme defined in this specification may be used, this section provides an example of an interconnect topology.

In this example, each rack can be equipped with a variable number of management plane and data plane switches (also referred to as Top of Rack switches). Each of these aggregate management and data traffic to internal network switch functions such as:

- **Device Management Switch:** The 1GbE IPMI management ports (i.e. BMC port) of each of the rack component (i.e. servers, switches, power control, etc.) are connected to the downlink ports on the platform management switch. The uplink ports (10GbE) can be connected to a cluster or end-of-row (EoR) aggregation switch in the datacenter.
- **Application Management Switch:** All servers in the rack connect to this switch using a lower speed 1GbE port. This switch provides connectivity between the rack servers and external cluster or EoR switches to an application management network. The uplink ports (10GbE) connect to the application management spine switches.
- **Primary Dataplane Switch:** All servers in the rack connect to the downlinks of the primary dataplane switch using their first 10GbE port. The switch uplink ports (40GbE) provide external connectivity to the cluster aggregation switches.
- **Secondary Dataplane Switch:** All servers in the rack connect to the downlinks of the secondary dataplane switch using their second 10GbE port. This switch uplink ports (40GbE) provide external connectivity to the cluster aggregation switches.

**Figure 27. Example Data Plane and Management Plane Architecture**

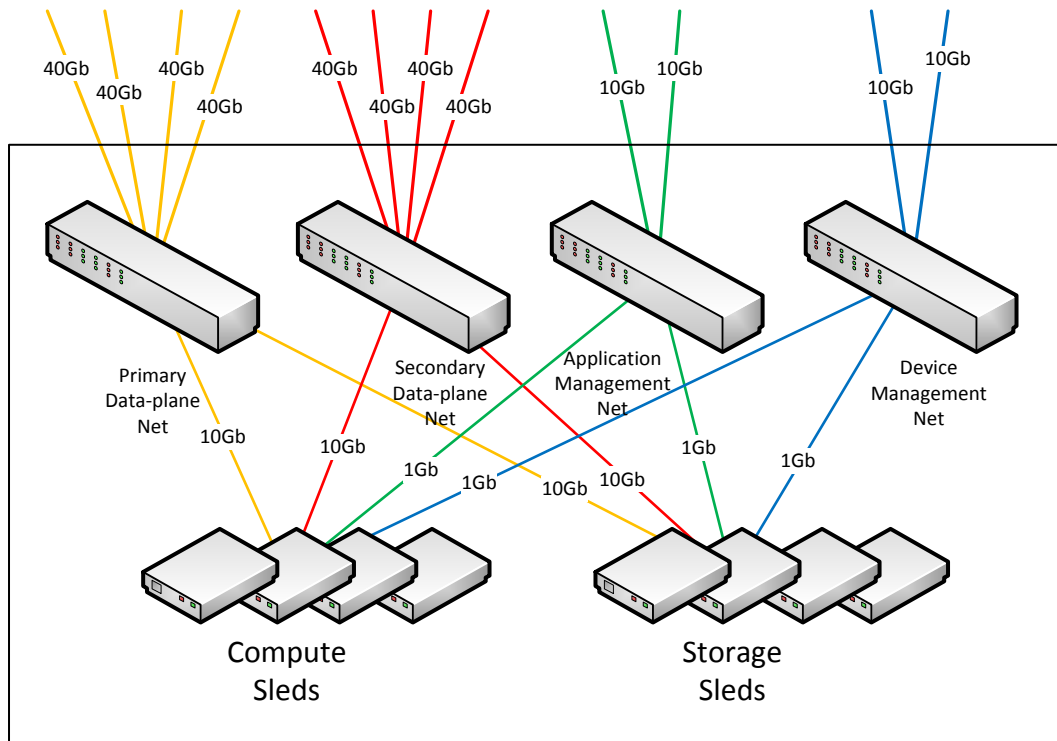

## 9 Electrical Specifications

### 9.1 Power

The sections that follow provide information about the power specifications for the sled.

#### 9.1.1 Power Connector

All sled power **shall** be supplied via a single DC power connector.



### 9.1.2 Input Voltage, Power, and Current

Table 4 lists the nominal, maximum, and minimum values for the sled input voltage. The maximum and minimum voltages include the effects of connector temperature, age, noise/ripple, and dynamic loading.

**Table 4. Input Voltage Range**

Nominal voltage	Maximum voltage	Minimum voltage
12.25V DC	12.95V DC	11.65V DC

The maximum amount of power allowed per sled is defined during system power allocation. The number of sleds in a chassis might be limited by the capacity of the AC power cord or by the cooling capacity of the deployment. Table 5 lists the input power allocation for a low-power sled (which may be either half- or full-width).

**Table 5. Input Power Allocation and Maximum Current**

Connector	Nominal voltage	System power allocation (in W)	Maximum current (in A)
Methode Mini-MCC Bus Connector	12.25VDC	1000W	105A

All sleds **shall** provide in-rush current control through the 12V bus rail; return-side in-rush control is not required. The in-rush current **shall** rise linearly from 0A to the full load current at a rate not to exceed 20A/ms. The ramp-up to full load **shall not** take more than 200ms).

### 9.1.3 Current Interrupt Protection

All sleds **shall** provide overcurrent protection at the point of power entry to the primary power distribution circuit.


### 9.1.4 Grounding and Return

All sleds **shall** directly connect the DC supply return to the enclosure case as part of a chassis grounding method.

## 9.2 Signal Interface

All interfaces between server nodes and the rack infrastructure pass through the blind-mate optical connector at the rear of the compute and storage sleds.

**Figure 28. Network connection to sleds**

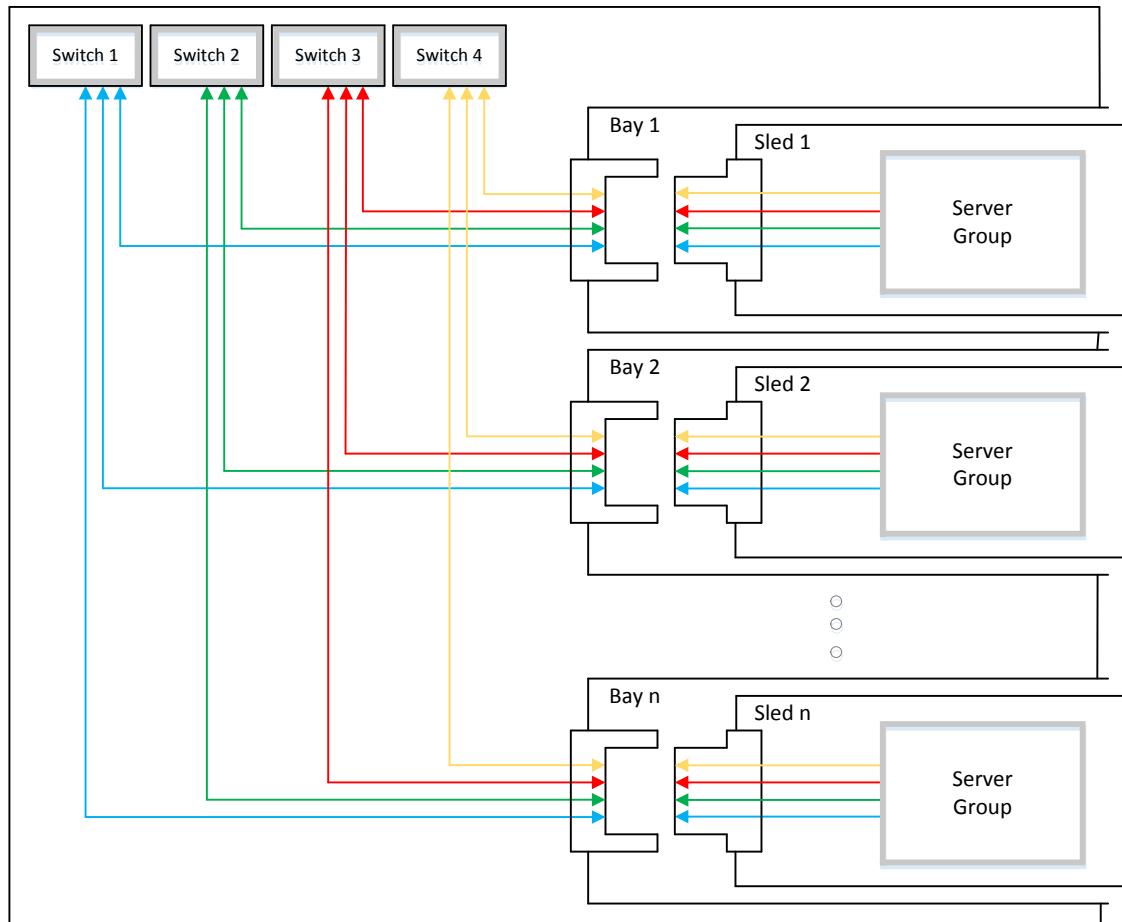


Note, this is a logical diagram; as described in the overview section, there may be 1 or 2 bays per shelf.

### 9.2.1 Sled Data Connections

Each sled connects to the rack-level networks via a set of up to four optical ferrules in a blind-mate housing system. This connector system is positioned at the rear face of each sled and at the back of each shelf. When the sled is installed on the shelf, all of the ferrules automatically align and connect, which ultimately connects the on-sled network interfaces to the rack-level network switches.

The optical blind-mate system and the in-rack optical cables provide the end-to-end network connections to all installed sleds.

**Figure 29. Sled Blind-Mate Optical Connections, Front View**

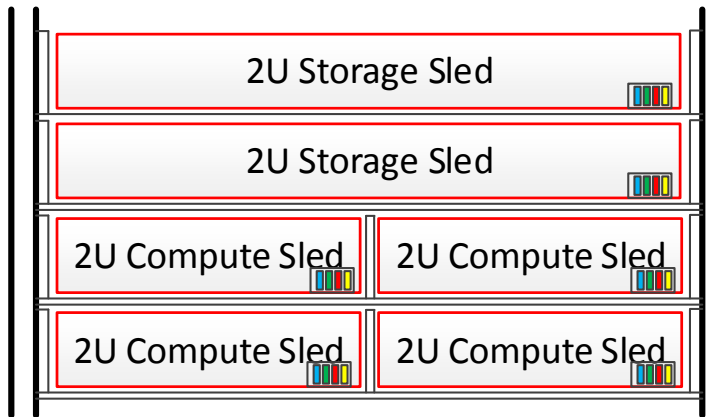

### 9.2.2 Signal Definitions

Table 6 below shows the fiber naming and assignments for the blind-mate optical interconnect.

**Table 6. Optical Connector Assignments**

Signal	Housing Section	Fiber Location	Description	Example Use (Switch Connections)
ENET_SW1.1_TX	Blue	1	1GbE (1000BASE-SX) lane	1Gb Device Management Plane connection (BMC IPMI link)
ENET_SW1.1_RX	Blue	12		
ENET_SW1.2_TX	Blue	2	1GbE (1000BASE-SX) lane	1Gb Device Management Plane connection (BMC IPMI link)
ENET_SW1.2_RX	Blue	11		
ENET_SW2.1_TX	Green	1	1GbE (1000BASE-SX) lane	1Gb Application Management Plane connection
ENET_SW2.1_RX	Green	12		
ENET_SW2.2_TX	Green	2	1GbE (1000BASE-SX) lane	1Gb Application Management Plane connection
ENET_SW2.2_RX	Green	11		

Signal	Housing Section	Fiber Location	Description	Example Use (Switch Connections)
ENET_SW3.1_TX	Yellow	1	10GbE (10GBASE-SR) lane	10Gb Primary Dataplane connection
ENET_SW3.1_RX	Yellow	12		
ENET_SW3.2_TX	Yellow	2	10GbE (10GBASE-SR) lane	10Gb Primary Dataplane connection
ENET_SW3.2_RX	Yellow	11		
ENET_SW4.1_TX	Red	1	10GbE (10GBASE-SR) lane	10Gb Secondary Dataplane connection
ENET_SW4.1_RX	Red	12		
ENET_SW4.2_TX	Red	2	10GbE (10GBASE-SR) lane	10Gb Secondary Dataplane connection
ENET_SW4.2_RX	Red	11		

Note: "Tx" and "Rx" are as referenced from the rack-level switch ports

Note: The example usage assumes the topology described in section 8.3; other use cases are possible.

Note: The fiber signals are presently defined at 1Gb/s and 10Gb/s speeds; future speed increases are possible.

### 9.3 Electromagnetic Interference Mitigation

The emission level of CG-OpenRack-19 sleds will be tested as part of a complete system. Because of this, sleds must be tested as part of a fully loaded rack-level configuration, including power distribution, power conversion, switching networks, and a maximum population of sleds.

Sleds **shall** meet FCC Class A when tested as a maximum population in a fully loaded rack-level system operating with a representative computational and data transmission workload.

## 10 Management

Each CG-OpenRack-19 server **shall** have a dedicated BMC for various out-of-band platform management services.

The health status of host processor **should not** affect the normal operation and network connectivity of the BMC.

The BMC **shall not** share memory with host processor.

The BMC management connectivity **should** work independently from host, and have no NIC driver dependency for Out-of-Band communication if using a shared-NIC.

The BMC **shall** support a remote console, also known as Serial-Over-LAN (SOL) through the management network.

POST codes **should** be displayed in SOL console during system POST.

Before the system has the first screen, POST codes **should** be stored and displayed in the SOL console in sequence. For example, display as "[00] [01] [02] [E0]..." etc. After the system has the first screen in the SOL console, the last POST code received on port 80 is displayed in the lower right corner of the SOL console screen.

The BMC **should** support high-performance remote KVM and remote storage over the management interface.

The BMC **shall** be fully IPMI 2.0 and DCMI 1.5 Compliant.

BMC firmware **shall** support remote system power on/off/cycle and warm reboot through In-Band or Out-of-Band IPMI commands

BMC firmware **shall** support a power-on policy selectable to be last-state, always-on, and always-off. The default setting is last-state.

A change of power policy **should** be supported by IPMI command and take effect without a BMC firmware cold reset or a system reboot.

Vendors **should** provide tool(s) to implement remote BMC firmware update, which will not require any physical access to the system. Remote update means either through Out-of-Band by management network or through In-Band by logging into local OS with data network.

Note – Server/node BMC IP addresses within sled locations can be discovered heuristically; there is no specification for any explicit/out of band identification mechanism.

## 11 Appendix

### 11.1 Appendix: Commonly Used Acronyms

This section provides definitions of acronyms used in the system specifications.

**BIOS** – basic input/output system

**BMC** – baseboard management controller

**CG** – Carrier Grade

**DCMI** – Data Center Manageability Interface

**EOR** – end of row

**IPMI** – intelligent platform management interface

**NIC** – network interface card

**OU** – Open Compute Rack Unit (48mm)

**POST** – power-on self-test

**RU** – rack unit (1.75")

**SOL** – serial over LAN

**TOR** – top of rack

**U** – rack unit (short for RU)